




SPECIFICATION SHEET : WHCG2-120-T8-IS


This Is An Original Product From Fulham Co., Inc

Description : WORKHORSE Commercial Grade Series Electronic Ballast, Drop In Replacement for Magnetic Ballast, Parallel Lamp Operation, THD Less Than 20%

This Ballast Will Operate Following Lamps.



F17T8 / F25T8 / F32T8




FOB31T8


ELECTRICAL DATA

INPUT VOLT: 120V $\pm$ 10%, 50/60Hz									
LAMP WATTS/TYPE	F25T8	F32T8	F40T8	FOB31T8	F17T8	F25T8	F32T8	FOB31T8	-
LAMPS OPERATED	1				2				
INPUT WATTS	29.00	36.00	43.13	35.45	32.00	45.00	57.00	56.91	
LINE CURRENT:	0.28	0.33	0.37	0.32	0.30	0.39	0.48	0.48	
POWER FACTOR	> 0.90								
BALLAST FACTOR	> 0.87								
EFFICACY FACTOR	3.577	2.885	2.303	2.710	2.801	1.993	1.513	1.443	
THD	< 20 %								
CURRENT CREST FACTOR	< 1.7								
EMI/RFI COMPLIANCE	FCC PART 18-A								
SOUND RATING	" A "								
BALLAST TYPE	INSTANT START								
VOLTAGE TRANSIENTS	ANSI C82.11 - 1993								
INPUT/PROTECTION	FUSE								
OUTPUT/PROTECTION	-								
MIN. STARTING TEMP	- 18 $^{\circ}$ C (0 $^{\circ}$ F)								
MAX. CASE TEMP	70 $^{\circ}$ C (158 $^{\circ}$ F)								
TYPE "HL" APPROVAL	APPROVED FOR HAZARDOUS LOCATION								
ENERGY STAR 4.0	-								
APPROVALS/CLASS	UL /cUL LISTED, CLASS " P ", 1 OUTDOOR								

MECHANICAL DATA

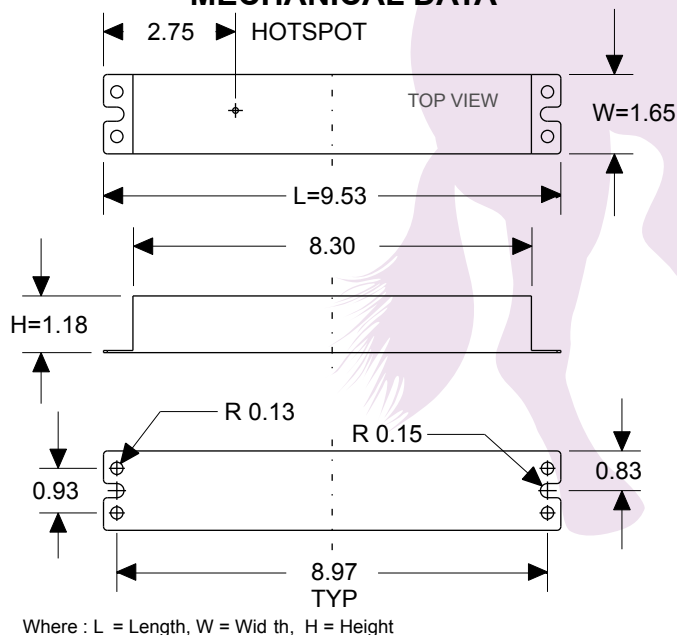

WIRING DIAGRAMS

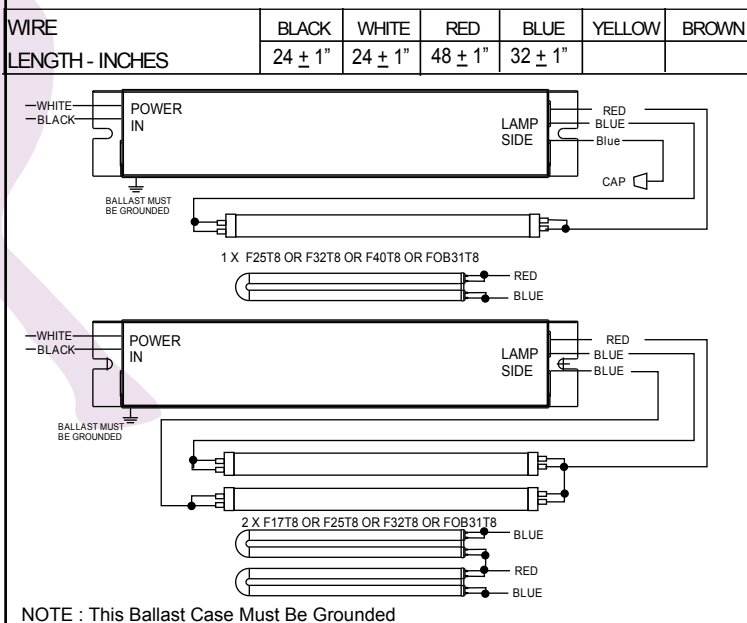

Fulham Co., Inc extends limited warranty only to the original purchaser or to the first user for the period of **5 years** from the date of manufacture as indicated by the date code stamped on each product and when properly installed and under normal conditions of use. For additional warranty guide line, please refer to our Complete Product Catalog OR call Customer Service at 1-323-599-5000.

DUE TO A PROGRAM OF CONTINUOUS IMPROVEMENT, FULHAM Co., INC RESERVES THE RIGHT TO MAKE ANY VARIATION IN DESIGN OR CONSTRUCTION TO THE EQUIPMENT DESCRIBED.

Address : 12705 South Van Ness Ave., Hawthorne, CA 90250 Tel.: 1-323-599-5000, Fax.: 1-323-754-9060. Website: www.fulham.com

2006-58 rev B